


Echiparea completa a tabloului TGD este specificata in norma locala NL1.

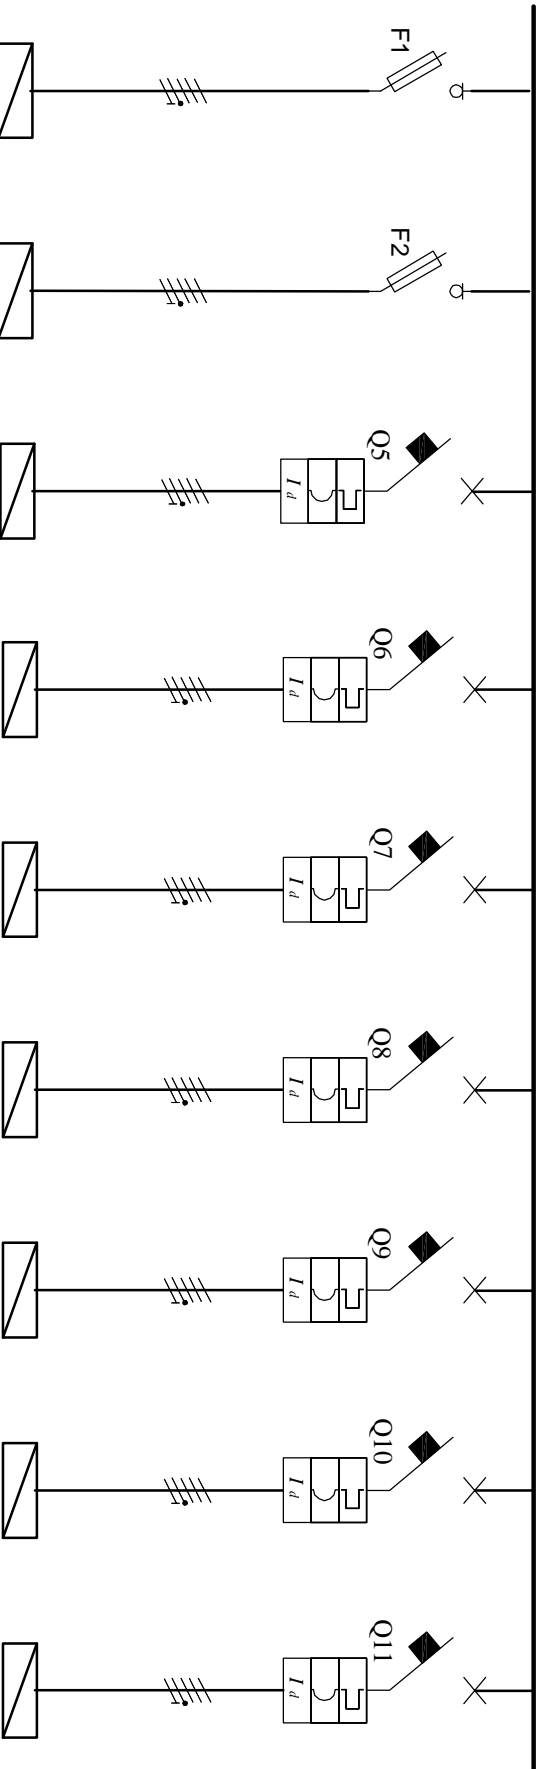

ACEASTA SCHEMA POATE FI COPIATA, UTILIZATA IN ALTE APLICATII SAU TIPARITA NUMAI CU ACORDUL SCRIS AL FARA MIHAI P.F.A.

Denumire	alimentare TH	alimentare TCT	alimentare TTD	alimentare TED	alimentare TM1	alimentare TM2	alimentare TM3	alimentare TF1	alimentare TF2	
Consumator										
Nr. circuit / Faza	5 / RST	6 / RST	7 / RST	8 / RST	9 / RST	10/ RST	11 / RST	12 / RST	13 / RST	
Putere totala [kW]	*30	*30	PI=21.8 ; Ps=14	PI=21.5 ; Ps=14	PI=15.1 ; Ps=10	PI=17.1 ; Ps=12	PI=11 ; Ps=8	PI=8.9; Ps=7	*max. Pc=22	
Tip	separator cu fuzibile	separator cu fuzibile	magnetotermic	magnetotermic	magnetotermic	magnetotermic	magnetotermic	magnetotermic	magnetotermic	
Poli	3P+N	3P+N	4P	4P	4P	4P	4P	4P	4P	
In [A]	160*/100 A	160*/100 A	C 32	C 32	C 32	C 32	C 32	C 25	C 63	
Capacitate scc. [kA]			10	10	10	10	10	10	10	
In [A]			300 mA; tip S	300 mA; tip S	300 mA; tip S	300 mA; tip S	300 mA; tip S	300 mA; tip S	300 mA; tip S	
Diferential			1 s	1 s	1 s	1 s	1 s	1 s	1 s	
Temporizare										
Fuzibili										
Tip										
Calibru [A]										
Contactor										
Tip										
Pn [kW] In [A]										
Releu										
Tip										
Domeniu [A]										
Tip cablu	FGTOR	FGTOR	FGTOR	FGTOR	FGTOR	FGTOR	FGTOR	FGTOR	FGTOR	
Compus din	*4x35 mm ²	*4x35 mm ²	5x6 mm ²	5x6 mm ²	5x6 mm ²	5x6 mm ²	5x6 mm ²	5x6 mm ²	5x16 mm ²	
Lungime [m]	25	20	-	-	-	-	-	-	-	
Cablu	PVC exec. grea / Ø63	PVC exec. grea / Ø63	PVC exec. grea / Ø32	PVC exec. grea / Ø32	PVC exec. grea / Ø32	PVC exec. grea / Ø32	PVC exec. grea / Ø32	PVC exec. grea / Ø32	PVC exec. grea / Ø50	
Tip tub tip / Ø [mm]										
Accesorii	igheab metalic	igheab metalic	igheab metalic	igheab metalic	igheab metalic	igheab metalic	igheab metalic	igheab metalic	igheab metalic	
Accesorii	OIZn 25x4 mm	OIZn 25x4 mm								
Observatii	*99 va conține cu TH existent! *99 va conține cu TCT existent! nu se monteaza acum nu se monteaza acum nu se monteaza acum nu se monteaza acum nu se monteaza acum nu se monteaza acum nu se monteaza acum nu se monteaza acum nu se monteaza acum nu se monteaza acum									

FARA MIHAI P.F.A

F35 / 284 / 2015; CUI: 34152874
 tel./fax: 0256-323.531; tel: 0722-646.157
 e-mail: mihalata@yahoo.com

Denumire:

CORPUL R. Modificare instalatii electrice si instalatii de securitate

Universitatea Politehnica Timisoara
 Vol 1. INSTALATIILE ELECTRICE. TGD si spatii comune
 Tabloul TGD. Schema monofazata

Proiectat:

ing. Mihai FARA
 autorizatie gr. III A. nr. 34201 / 2014

Desenat:

ing. Mihai FARA
 autorizatie gr. III A. nr. 34201 / 2014

DATA:

10.06.2017

PAGINA:

2

DESEN NR:

9.1/2017-09-E

TOTAL PAGINI:

4